

Basicline

Wired control system for underfloor heating system

The Roth Basicline system is used for individual control and adjustment of the room temperature with underfloor heating systems. At just 18 mm, these thermostats are some of the thinnest on the market.

A Basicline system consists a 6 or 12-channel control unit wired to the thermostats. These are available in a standard version, or a version with a floor sensor (multi-thermostat).

Technical description

Roth Basicline is a wired, 24-volt system designed for underfloor heating systems. It has been developed especially for the Nordic market by Roth Nordic, and the system is suitable for all Roth shunt/mixers and distributor systems.

The system has a wide range of features that makes it quick and easy to install, while ensuring perfect yet economical comfort for user and long service life for the pump, valves and actuators.

There are two thermostat variants available; a standard version and a multi version, both in white RAL 9016.

The thermostats come equipped with an LED behind the front which lights up when there is heat demand. The rotary knob is used to set the temperature.

The multi-thermostat comes complete with a floor sensor and sensor option for determining a maximum floor temperature or a minimum comfortable floor temperature.

The control unit can be mounted on a standard 35 mm DIN rail or using ordinary bolts.

An LED indicates whether there is heat demand on the individual channels and whether there is power to the control unit. The thermostats are connected by means of an ordinary 0.34 mm² wire with 4 conductors. The thermostats are enrolled automatically when the cable is connected. The control unit has a 230 V pump relay, and the pump is powered directly from the control unit. The control unit also has a relay for boiler control.

First start-up: The first time an underfloor heating system is started up, all actuators should be opened fully in order to ensure correct function, it is also important to vent all air out of the system, this is ensured automatically by the Basicline system when a power supply is connected, as a forced automatic heat demand is applied in the first 10 minutes after connection of the power supply.

Note: Basicline executes the first start-up sequence after all power outages.

Pump exercise: The Basicline system performs a automatic pump exercise for 10 seconds once every 14 days in order to extend the service life of the pump and ensure that the pump does not seize.



Valve and actuator exercise: Automatic valve and actuator exercise is performed every 14 days for 3,5 minutes at a time, in order to ensure long service life and guarantee valve and actuator function.

The multi-thermostat allows a minimum or maximum floor temperature to be set. The temperature is set behind the potentiometer cover. Maximum or minimum is selected by positioning a jumper. Removing the jumper behind the cover this connects the floor sensor and the multi-thermostat operates as a standard thermostat.

It is possible to purchase a timer so that zoned night reduction can be executed.

Baseline

Thermostat error codes

LED flashes once.

Error in internal thermostat sensor. Thermostat must be replaced.

LED flashes twice.

External floor sensor at thermostat short-circuited or switched off.

Replace floor sensor or remove jumper in thermostat.

An emergency programme at 30% heat is run in the event of a thermostat error.

Operating times

Pump exercise for 10 seconds every 14 days.

Valve exercise for 3.5 minutes every 14 days.

First start-up forced heat demand for 10 minutes.




Pump over time active, 1 minute.

Pump delay on heat demand 4 minutes.

Dead zone between last heat demand and pump delay 1 minute.

Technical data

Application	Wired underfloor heating systems
Room thermostat	
Basicline room thermostat, standard	HVAC no. 7466394100
Voltage	24V
Temperature setting	5 - 30°C
Protection rating	IP 20
Max. cable length	30 m
Multi-thermostat	
Basicline room thermostat, multi	HVAC no. 7466394140
Voltage	24V
Temperature setting	5 - 30°C
Floor temperature restriction	18 - 45°
Factory setting	Max. 25°C
Max. temperature, wooden flooring	Follow the floor manufacturer's instructions
Recommended min. temperature, (e.g.) tiled flooring	25°C
Protection rating	IP 20
Floor sensor 3 m	NTC 12 kOhm 25°C
Max. cable length	30 m

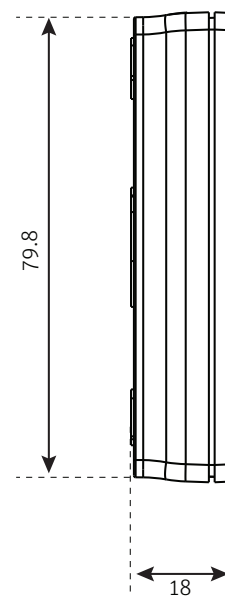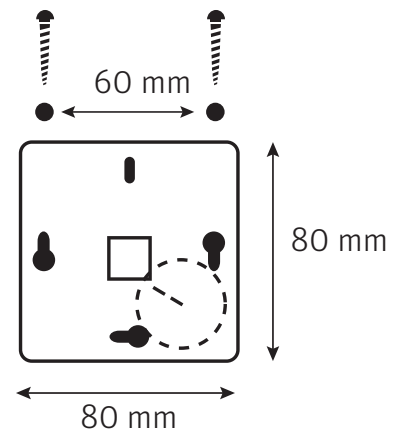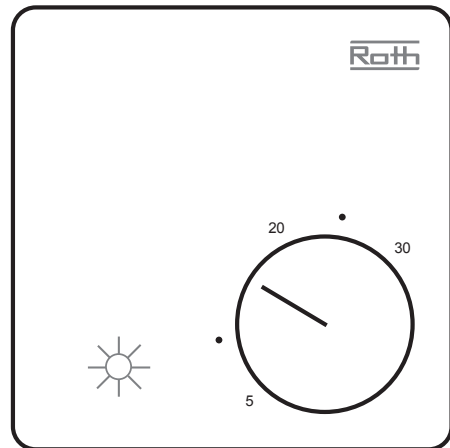

Baseline

Control unit

Baseline control unit, 6 channels
 Baseline control unit, 12 channels
 Voltage

Maximum permitted fuse

Internal fuse type

Output voltage

Boiler output (zero potential)

External pump output

Storage temperature

Operating temperature

Timer signal

Transient voltage

Standby consumption

Protection rating

Actuator type

Max. actuators, 6 channels:

Max. actuators, 12 channels:

Max. actuators per channel:

Night reduction

Mains cable

HVAC no. 7466394006

HVAC no. 7466394012

230V AC $\pm 10\%$

50/60 Hz

13 A

0217.400 0.4 AF

24V AC

230V AC/Max. 2 A

230V AC/Max. 2 A

-20/+60°C

0/+50°C

(2) 24 V AC

4 kV

2.6W

IP 21

24V NC


12 x 1W

18 x 1W

5 x 1W

4°C from setpoint

2 m Schuko

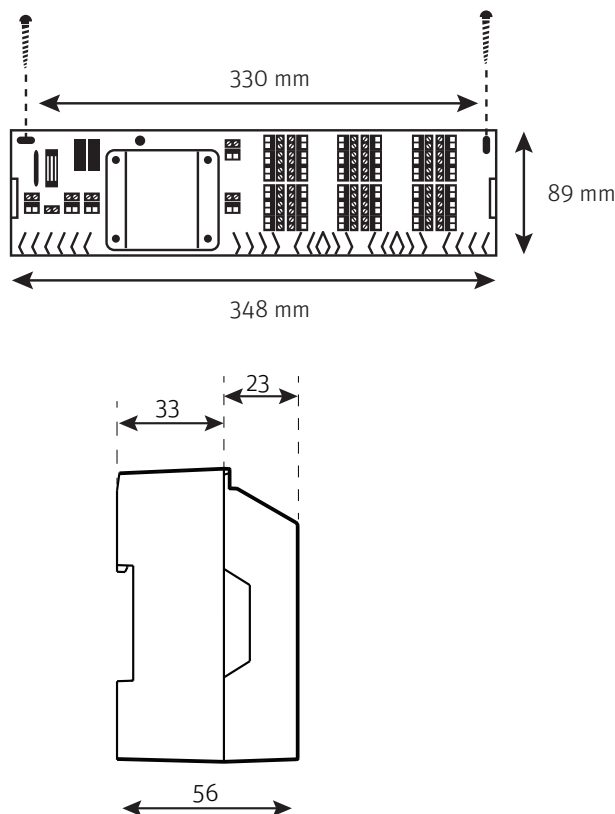

Wiring must be connected in compliance with local electrical regulations.

Accessories

Roth actuator

HVAC no. 7466275425

Roth Baseline floor sensor 3 m

NTC 12 kOhm 25°C

HVAC no. 70J1000001

Cable 100 m 4 x 0.34 mm²

HVAC no. 70J1000003

Fuse, littlefuse type 0217.400 0,4 AF

HVAC no. 70J1000000

Connection timer for night reduction

HVAC no. 70J1000002

Roth ShuntUnit, 1 - 8 circuits

HVAC no. 74662121x0


Roth GV distributor unit, 1 - 12 circuits

HVAC no. 74019730xx

Roth Baseline cover for room thermostat

HVAC no. 7466394910

Wiring diagram

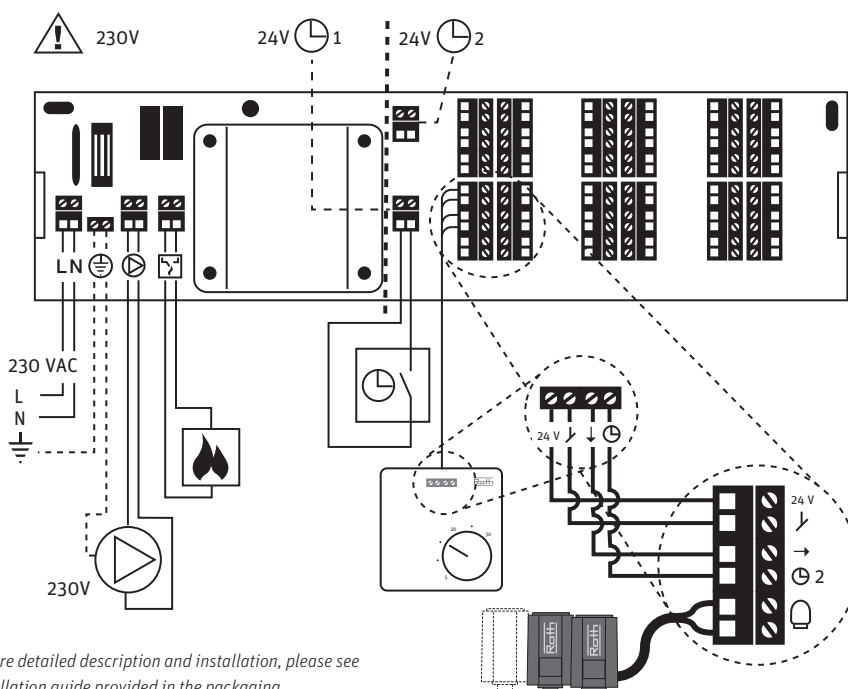

For a more detailed description and installation, please see the installation guide provided in the packaging.